

Media Statement


10 March 2016

Clarification

Basslink can confirm that at the time of the outage on 20 December 2015, its interconnector was importing power into Tasmania.

There has been some media reporting suggesting otherwise, however Basslink can confirm that these reports are incorrect.

The Basslink Power Flow Report below highlights that for the vast majority of the day of the outage, energy flow was from Victoria to Tasmania. It also shows that it was operating inside its design parameters. Basslink is designed to operate at a continuous rating of 500MW.

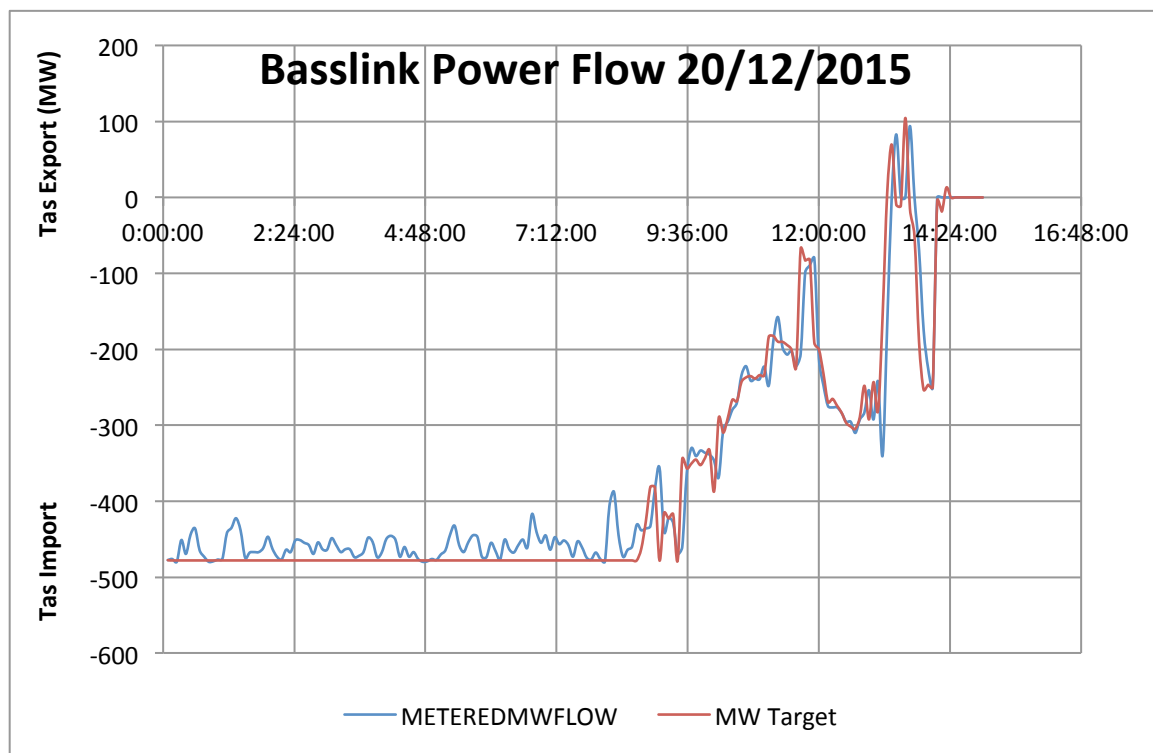

- Ends -

For further media enquiries on Basslink, please contact:

Matthew Mahon, Royce, 03 8628 9300 or 0413 101 860 matthew@royce.com.au

Yumeko Leung, Royce, 03 8628 9319 or 0402 127 903 yumeko@royce.com.au